

Certificate No.: H3 2020
 Date of Test: 2020/06/01
 Applicant: M Props
 Description: Heavy Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the Heavy Duty Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the Heavy Duty Camlok Prop

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	1.05	199.57	Hole Elongation
2	1.35	185.50	Hole Elongation
3	1.60	202.45	Hole Elongation

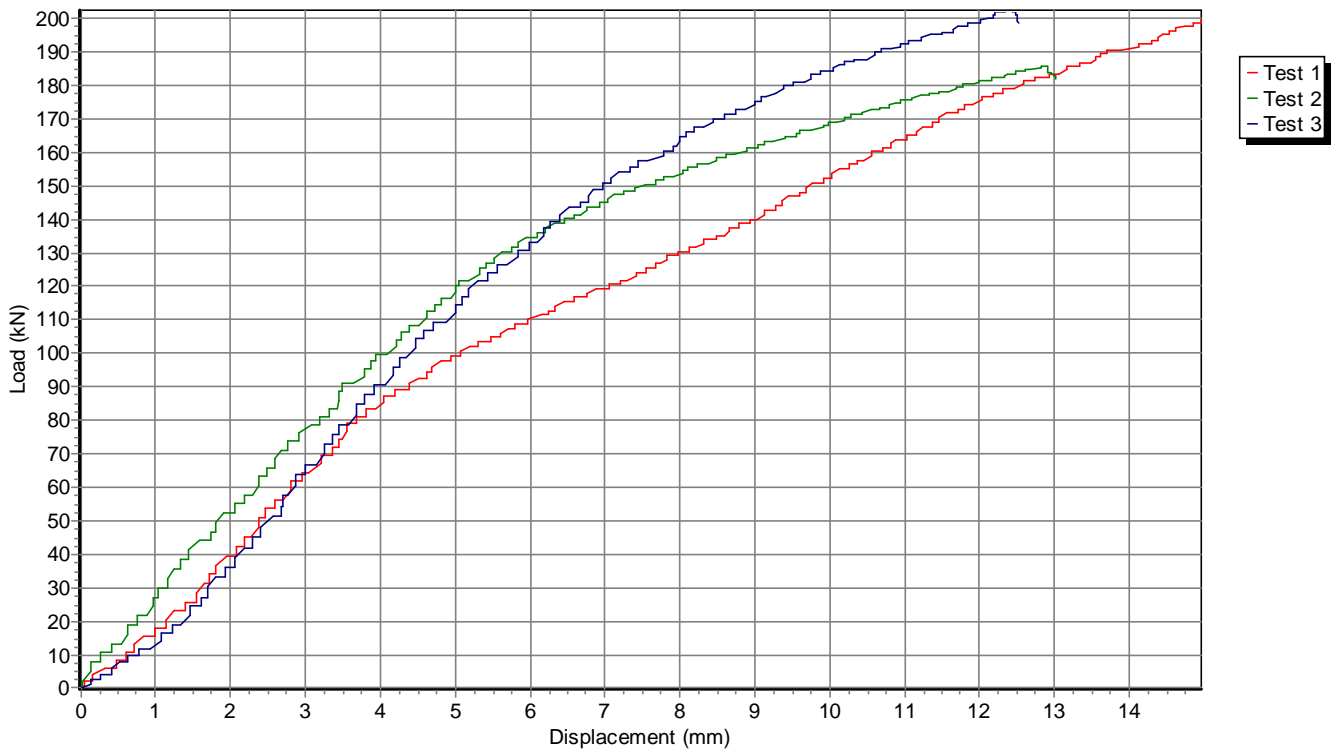

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer