

Certificate No.: H6 2020
 Date of Test: 2019/06/01
 Applicant: MProps
 Description: Heavy Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the H6 Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the H6 Camlok Prop

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	2.15	224.14	Hole Elongation
2	2.75	223.08	Hole Elongation
3	3.35	215.56	Hole Elongation - TUBE FLEX

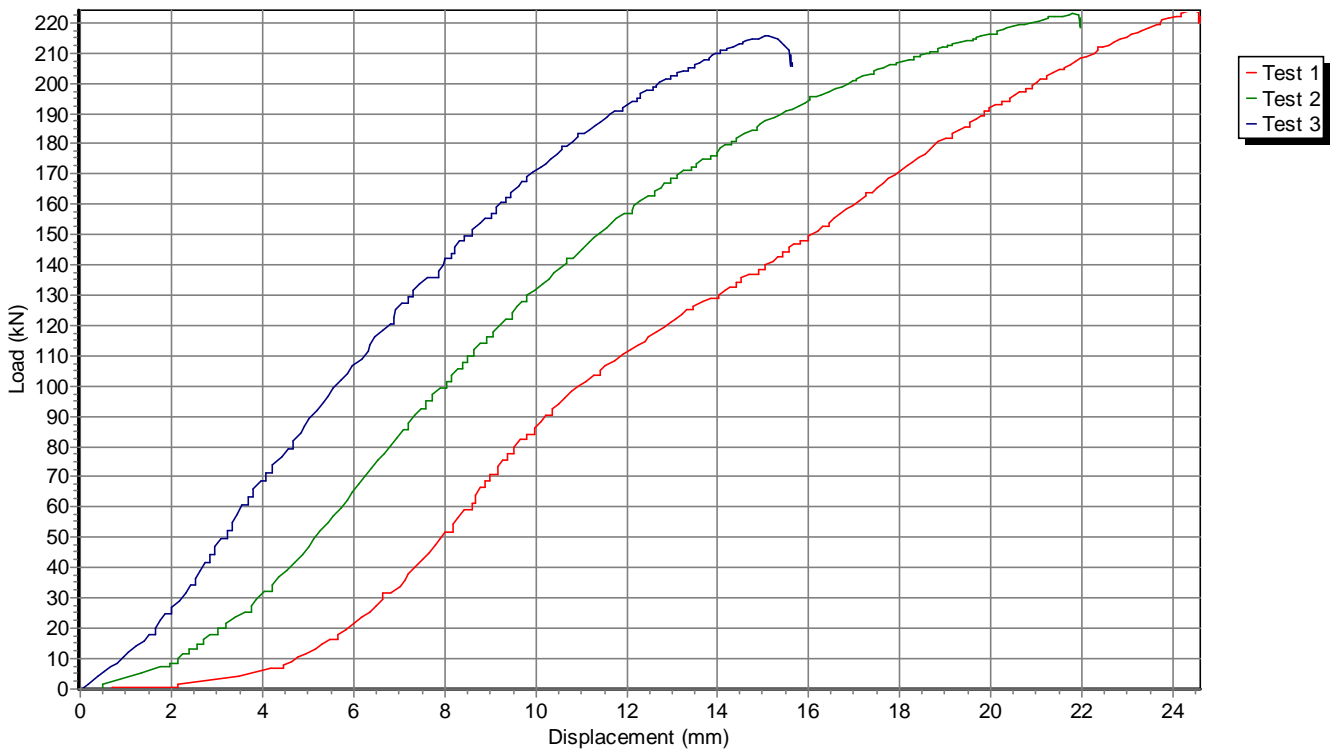

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer