

Certificate No.: H8 2020
 Date of Test: 2020/06/01
 Applicant: M Props
 Description: Heavy Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the Heavy Duty Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the Heavy Duty Camlok Prop

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	4.90	98.10	Inner Tube Flex
2	4.30	107.76	Inner Tube Flex
3	3.70	137.80	Inner Tube Flex

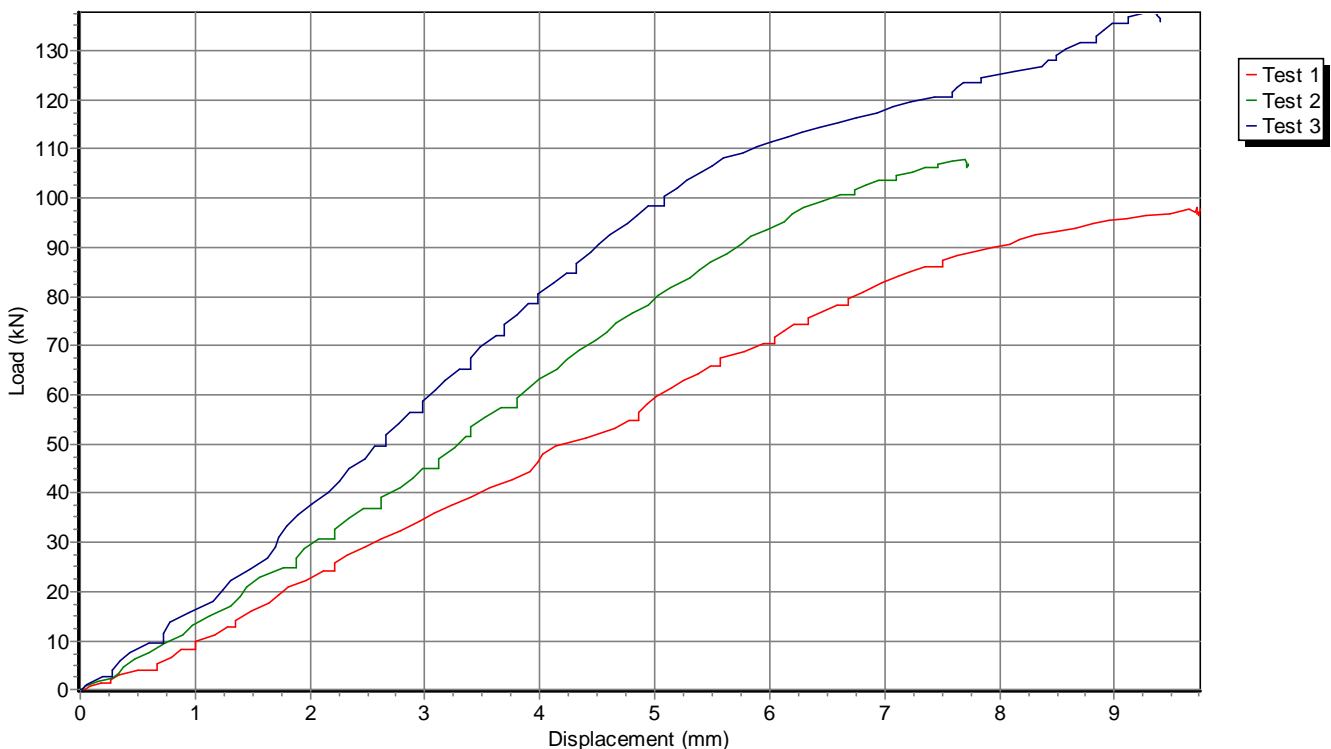

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer