

Certificate No.: M1 2020
 Date of Test: 2020/05/28
 Applicant: M Props
 Description: Medium Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the M1 Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	0.70	153.13	Hole Elongation
2	0.85	155.86	Hole Elongation
3	1.00	152.34	Hole Elongation

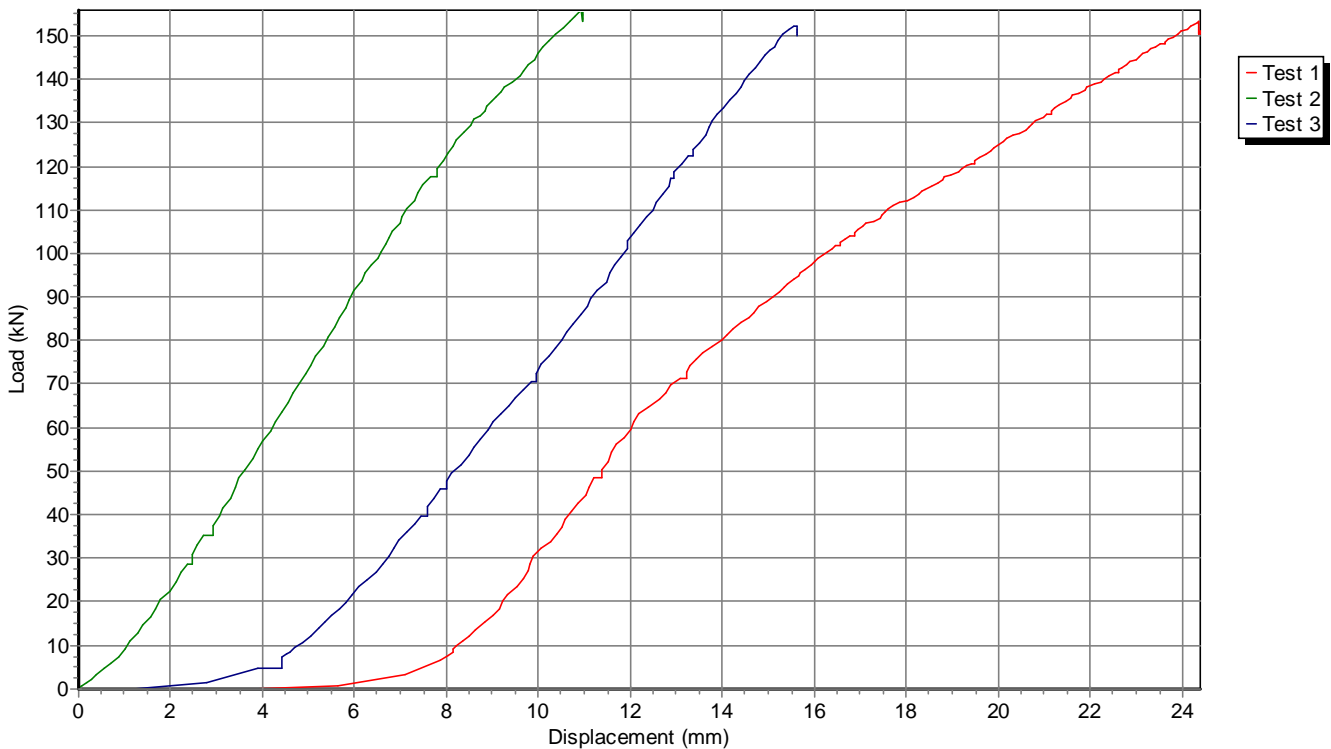

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer