

Certificate No.: M3 2020  
 Date of Test: 2020/05/28  
 Applicant: M Props  
 Description: Medium Duty Camlok Prop




## TEST RESULTS

The results of the compression test carried out on the Camlok Prop are summarised in Table 1.

**Table 1: Maximum load for the Camlok Prop**

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	1.00	151.09	Hole Elongation
2	1.25	150.59	Hole Elongation
3	1.50	151.78	Hole Elongation

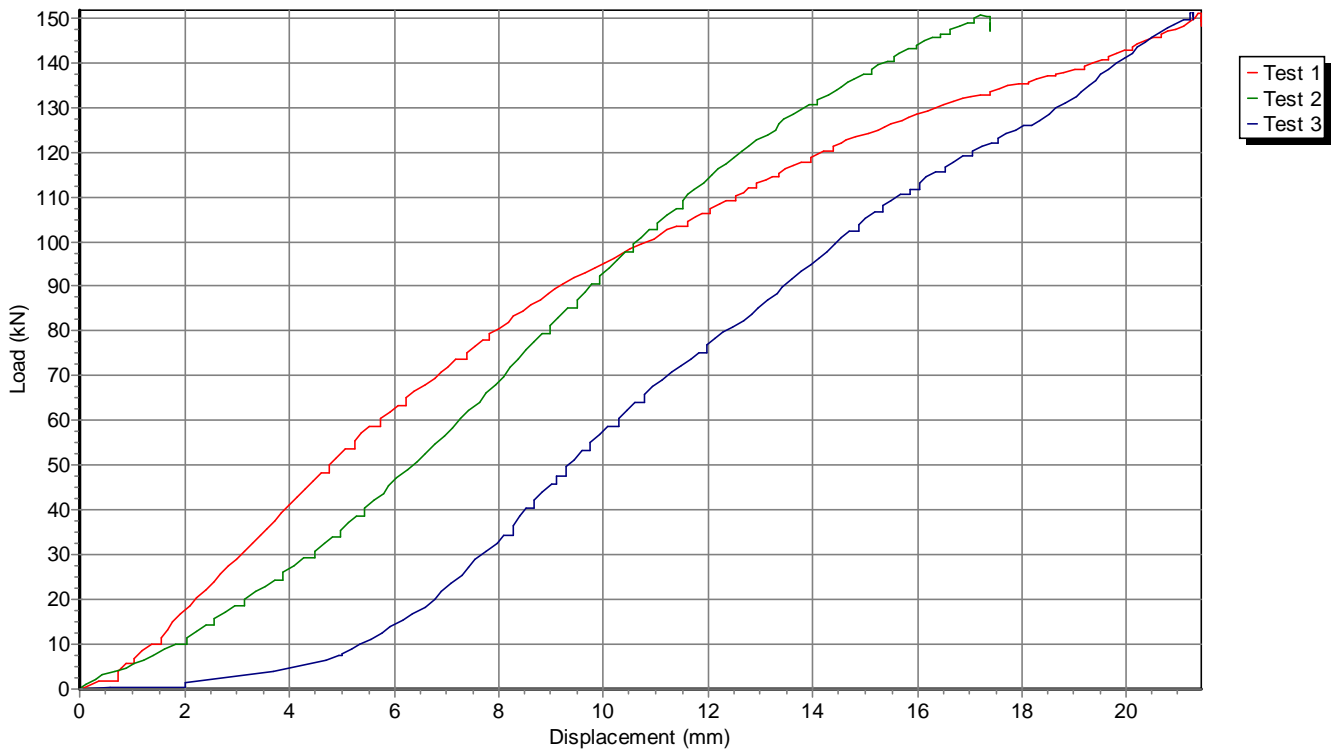

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer .....