

Certificate No.: M3A 2020
 Date of Test: 2020/05/28
 Applicant: M Props
 Description: Medium Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the Camlok Prop

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	1.10	134.19	Hole Elongation
2	1.40	131.60	Hole Elongation
3	1.70	136.91	Hole Elongation

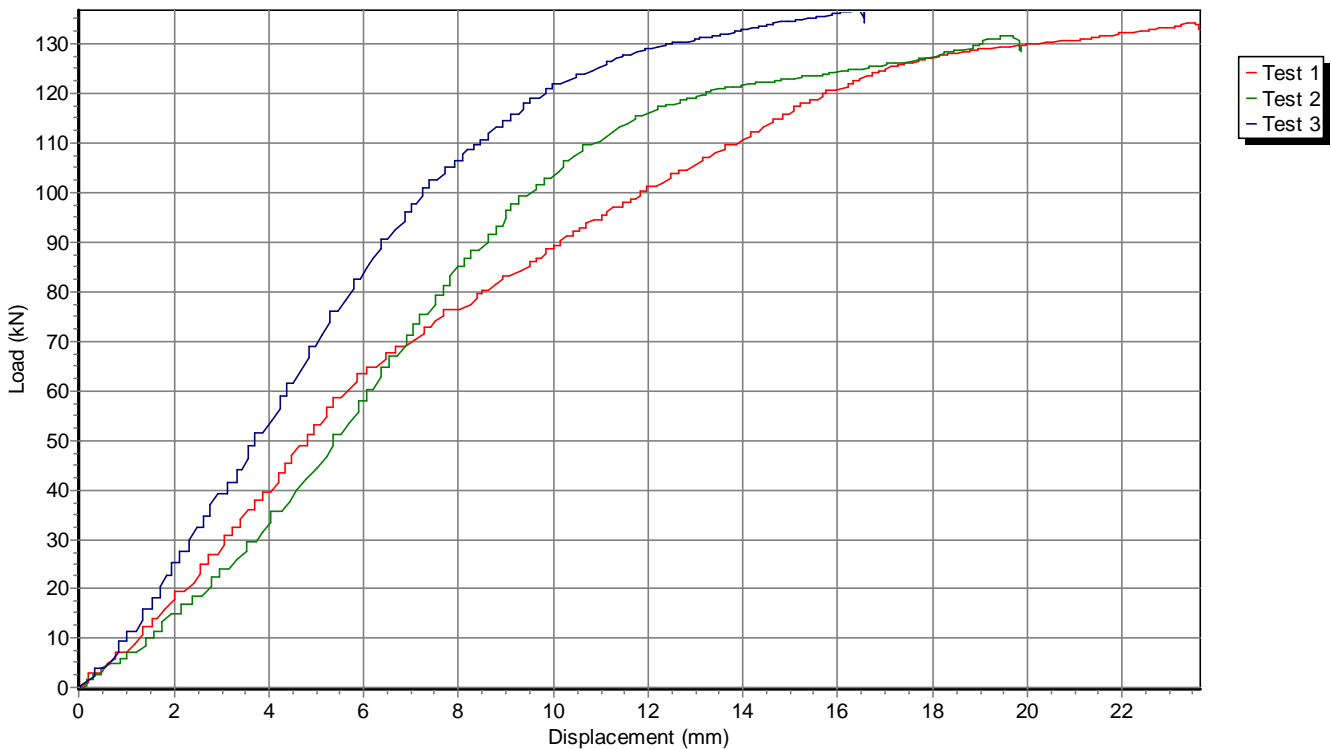

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer