

Certificate No.: M6 2020  
 Date of Test: 2020/05/28  
 Applicant: M Props  
 Description: Medium Duty Camlok Prop




## TEST RESULTS

The results of the compression test carried out on the Camlok Prop are summarised in Table 1.

**Table 1: Maximum load for the Camlok Prop**

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	2.10	123.74	Hole Elongation
2	2.70	136.05	Hole Elongation
3	3.10	128.16	Hole Elongation - Tube Flex

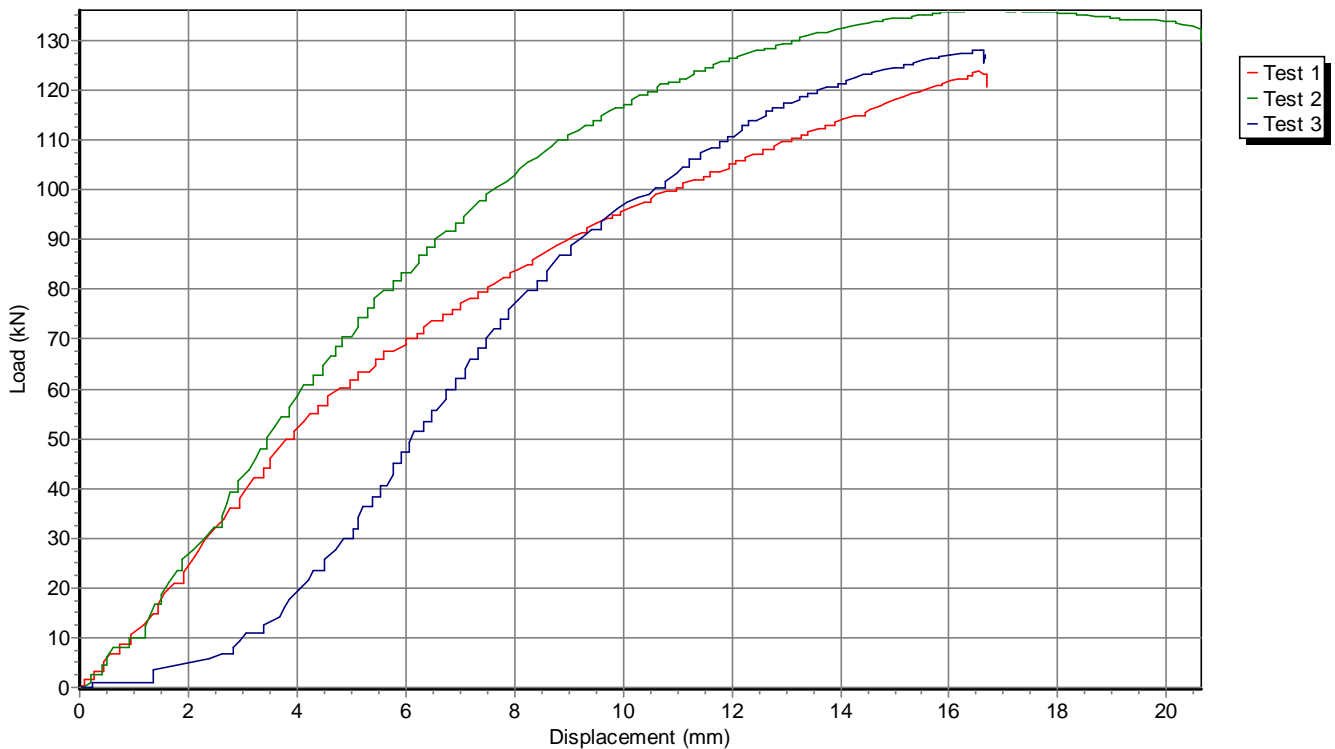

**Notice:** ONLY the original signed report must be regarded as the official document

Testing Officer .....