

Certificate No.: M8 2020
 Date of Test: 2020/05/28
 Applicant: M Props
 Description: Medium Duty Camlok Prop




TEST RESULTS

The results of the compression test carried out on the Camlok Prop are summarised in Table 1.

Table 1: Maximum load for the Camlok Prop

Test No	Test height (m)	Maximum load carried (kN)	Mode of failure
1	4.85	45.97	Tube Flex
2	4.25	76.03	Tube Flex
3	3.65	82.06	Tube Flex

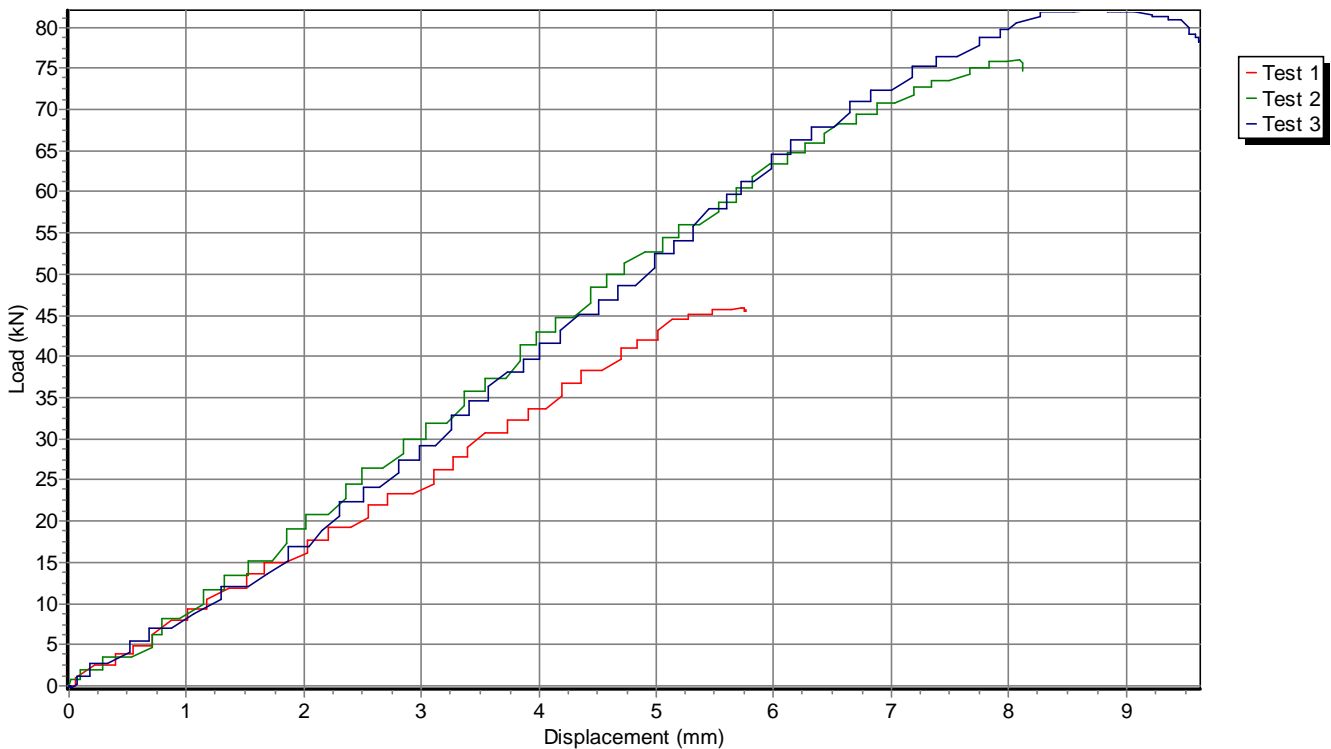

Notice: ONLY the original signed report must be regarded as the official document

Testing Officer